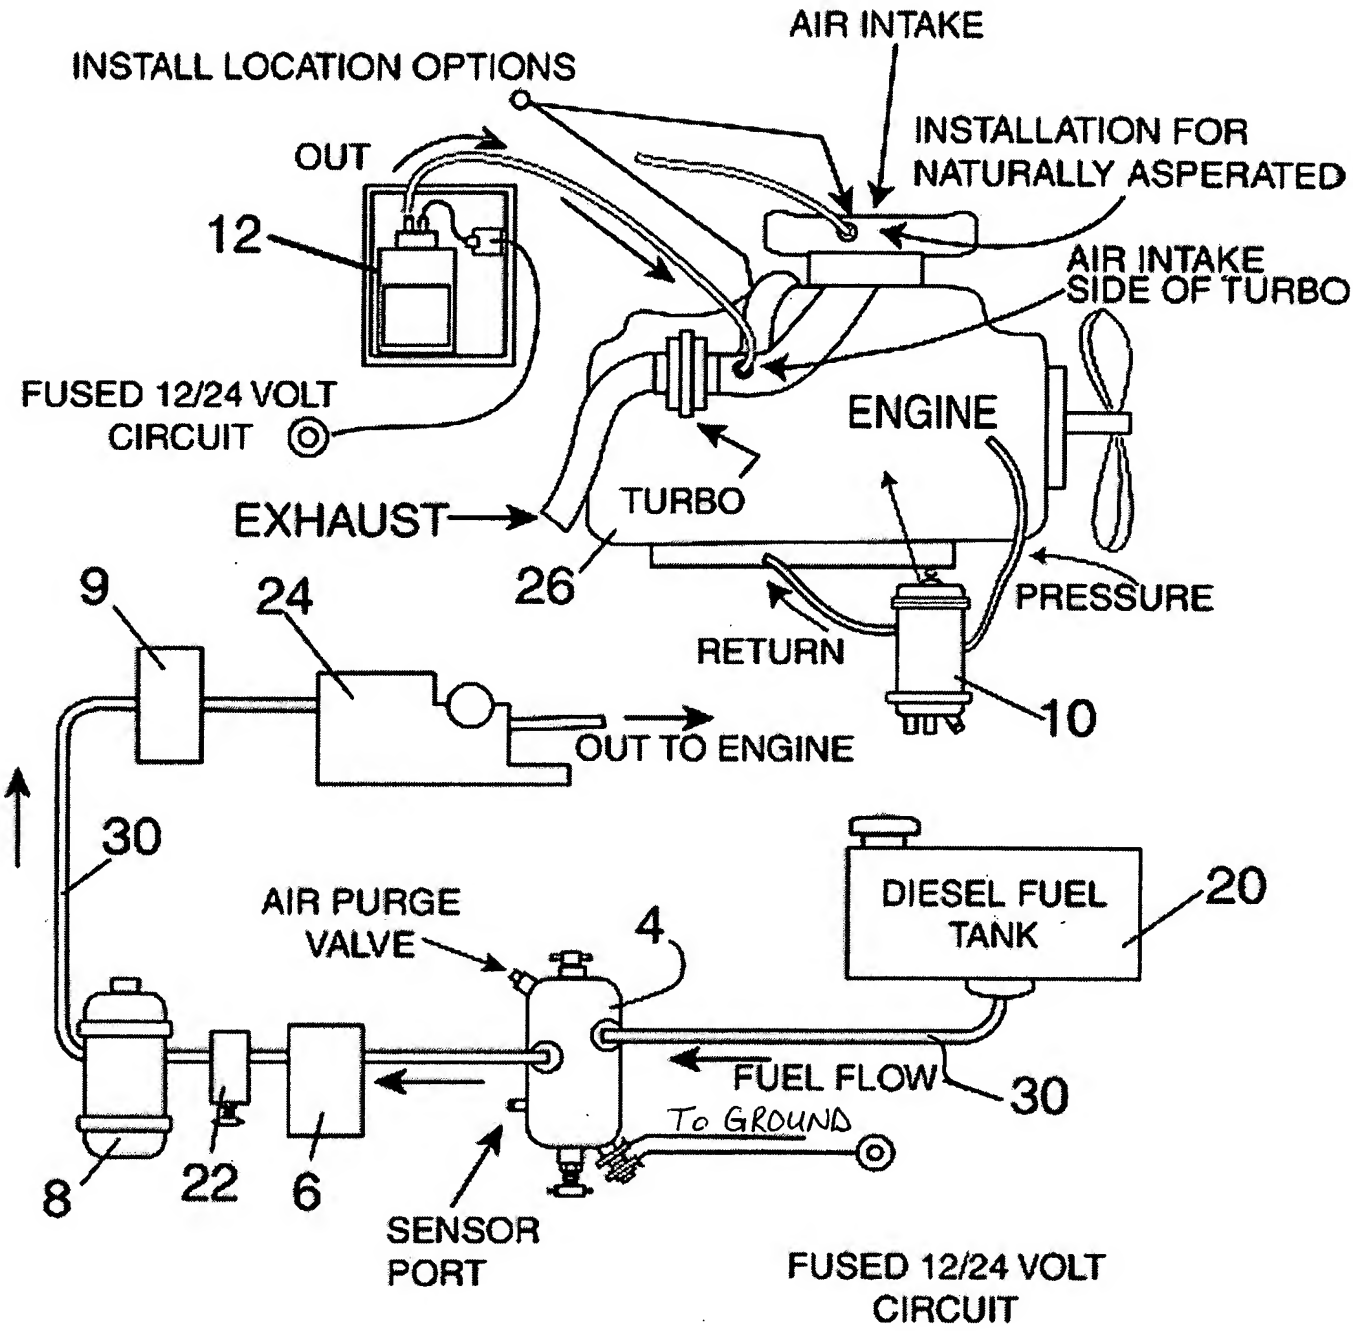
AIR INTAKE
INSTALL LOCATION OPTIONS
INSTALLATION FOR
NATURALLY ASPERATED
OUT
12
AIR INTAKE
SIDE OF TURBO
FUSED 12/24 VOLT
CIRCUIT
ENGINE
TURBO
EXHAUST
26
PRESSURE
9
24
RETURN
10
OUT TO ENGINE
30
DIESEL FUEL
TANK
20
AIR PURGE
VALVE
4
FUEL FLOW
30
To GROUND
8
22
6
SENSOR
PORT
FUSED 12/24 VOLT
CIRCUIT

FIG. 1